
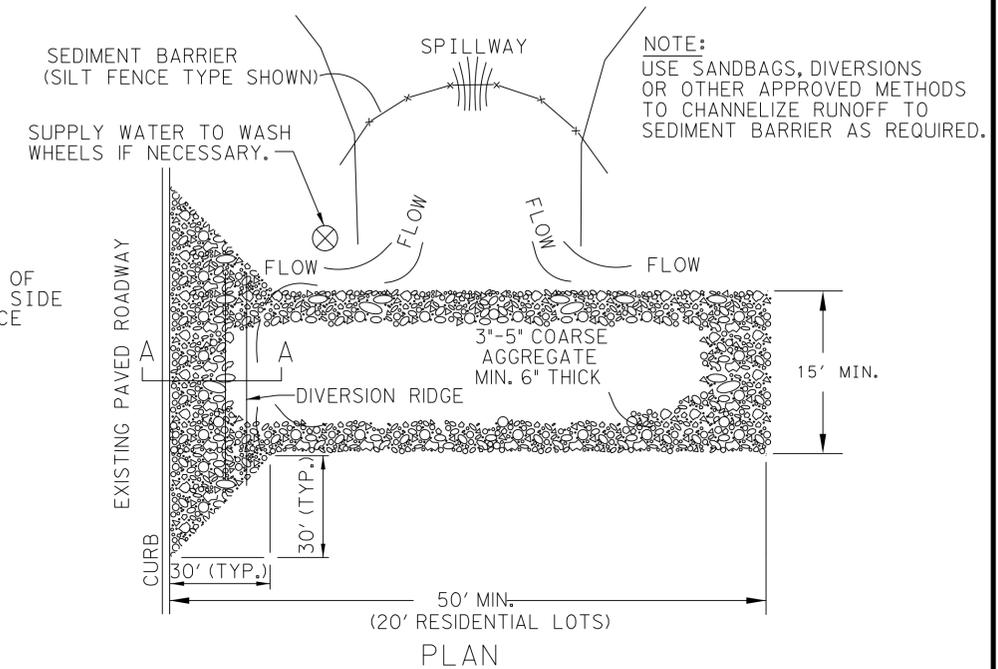
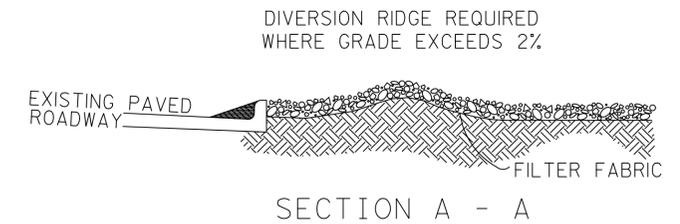



SILT FENCE GENERAL NOTES

- (1) STEEL POSTS WHICH SUPPORT THE SILT FENCE SHALL BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POST MUST BE EMBEDDED A MINIMUM OF ONE FOOT.
- (2) THE TOE OF THE SILT FENCE SHALL BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWNSLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (e.g. PAVEMENT), WEIGHT FABRIC FLAP WITH ROCK ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER FENCE.
- (3) THE TRENCH MUST BE A MINIMUM OF 6 INCHES DEEP AND 6 INCHES WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL.
- (4) SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IN TURN IS ATTACHED TO THE STEEL FENCE POST. THERE SHALL BE A 3 FOOT OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC MEET.
- (5) INSPECTION SHALL BE MADE EVERY TWO WEEKS AND AFTER EACH 1/2" RAINFALL. REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
- (6) SILT FENCE SHALL BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
- (7) ACCUMULATED SILT SHALL BE REMOVED WHEN IT REACHES A DEPTH OF HALF THE HEIGHT OF THE FENCE. THE SILT SHALL BE DISPOSED OF AT AN APPROVED SITE AND IN SUCH A MANNER AS TO NOT CONTRIBUTE TO ADDITIONAL SILTATION.


NOTE:
STONE OVERFLOW STRUCTURES OF OTHER OUTLET CONTROL DEVICES SHALL BE INSTALLED AT ALL LOW POINTS ALONG THE FENCE OR EVERY 300 FEET IF THERE IS NO APPARENT LOW POINT

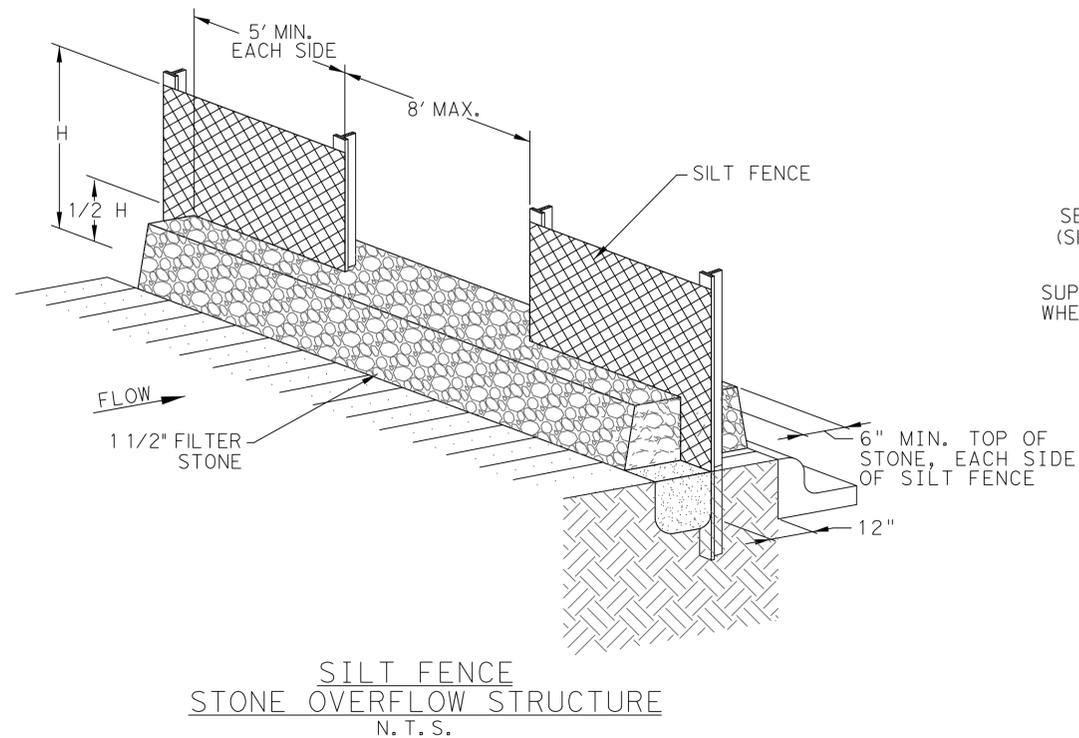

NOTE:
WHEN SEDIMENT HAS SUBSTANTIALLY CLOGGED THE VOID AREA BETWEEN THE ROCKS, THE AGGREGATE MAT MUST BE WASHED DOWN OR REPLACED. PERIODIC RE-GRADING AND TOP DRESSING WITH ADDITIONAL STONE MUST BE DONE TO KEEP THE EFFICIENCY OF THE ENTRANCE FROM DIMINISHING.

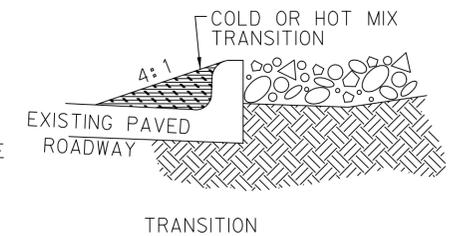

TEMPORARY STONE CONSTRUCTION ENTRANCE/EXIT N.T.S.

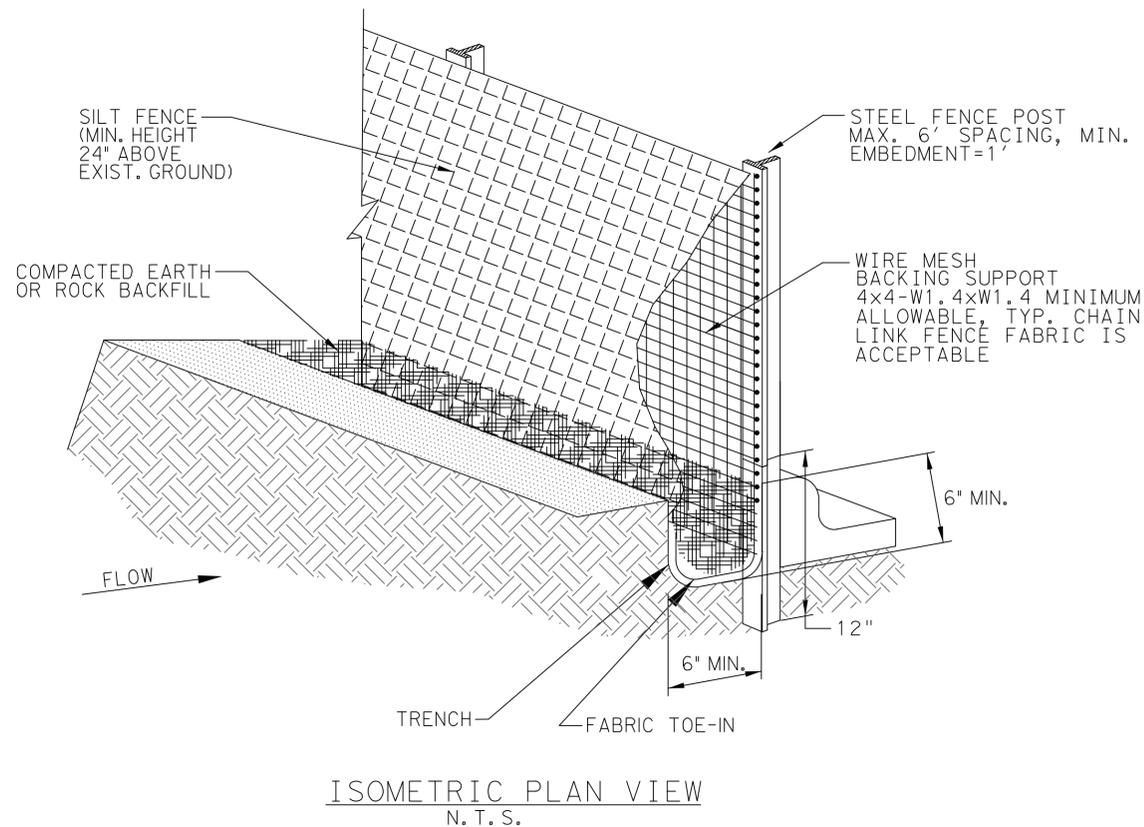

EC-1

CERTIFICATION:
THIS TOWN OF NORTHLAKE STANDARD DETAIL SHEET IS AUTHORIZED FOR USE IN THIS PROJECT BY THE ENGINEER WHOSE SEAL APPEARS ON THIS SHEET. THIS ENGINEER IS ALSO CERTIFYING THAT THE CONTENT OF THE DETAILS AND NOTES ON THIS SHEET HAVE NOT BEEN ALTERED FROM THAT RECEIVED FROM THE TOWN OF NORTHLAKE.





EROSION CONTROL STANDARD DETAILS

EROSION CONTROL DETAILS (SHEET 1 OF 2)




THE TOWN OF NORTHLAKE TEXAS

DESIGN	DRAWN	CHECK	DATE	SCALE	FILE	NO.
HALFF	HALFF	HALFF	AUG 2023	N. T. S.	EC-1	—

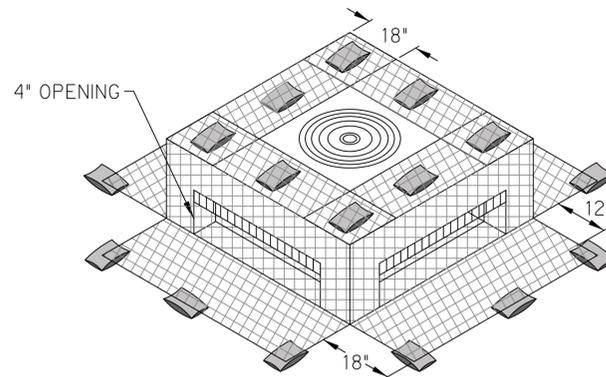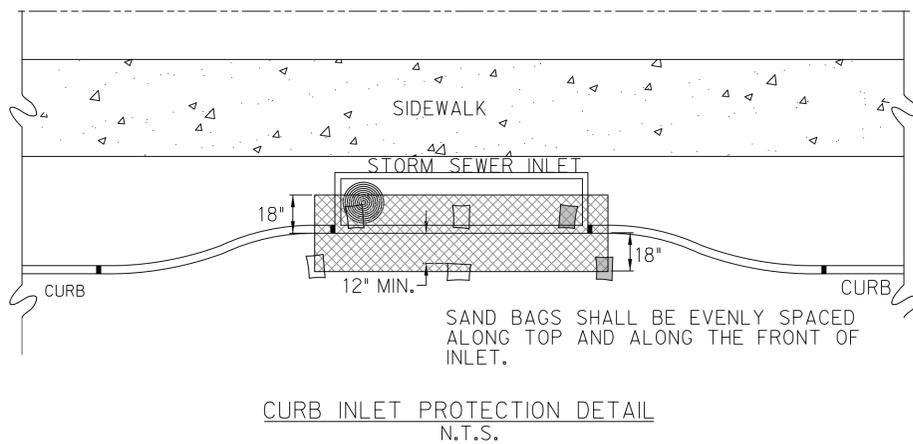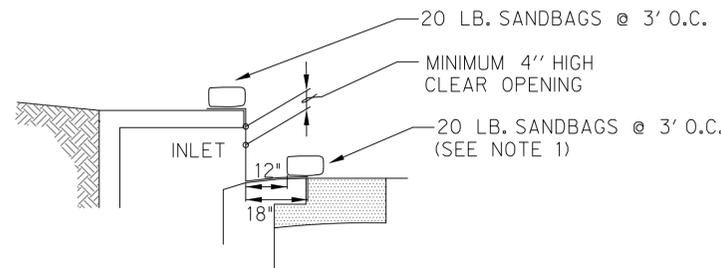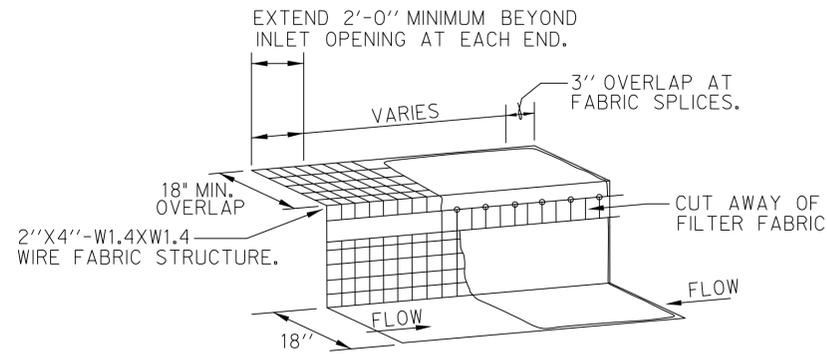

ISOMETRIC VIEW

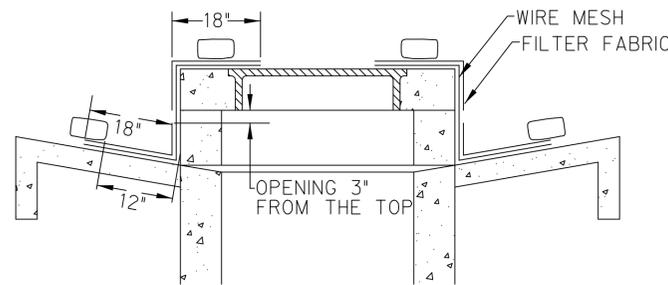

SECTION

FILTER FABRIC WYE INLET PROTECTION
N.T.S.

ESTABLISHMENT OF GROUND COVER

- (1) Eighty percent (80%) evenly distributed ground cover, without large bare areas, shall be established after the designated areas have been completed to the lines, grades and cross sections shown on the plans and prior to final acceptance by the Town.
- (2) Ground cover, for Seeding Turf Grass, shall be in accordance with the standard specifications of the Town of Northlake, which has also adopted the Fifth Edition of the "Standard Specifications For Public Works Construction - North Central Texas" herein referred to as "COG" specifications. Copies may be obtained from the North Central Texas Council of Governments, 616 Six Flags Drive, Suite 200, Arlington, Texas 76005-5888. (817) 640-3300. A copy of the contract documents, plans and specifications shall be available on-site at all times by the Contractor.
- (3) Refer to COG Item 204.6 specifications.
- (4) Prior to planting, contractor shall provide the Town with the State of Texas Certificate stating analysis of purity and germination of seed.
- (5) Planting season and application rates. All planting shall be done between the dates specified in Table 1, for each grass type except when specifically authorized in writing. The seeds planted per acre shall be of a type specified with the mixture, rate and planting dates as shown in the Table 1, or as specified by the Engineer.

Table 1. Seeding Turfgrass		
TYPE	PLANTING SEASON	SEED AND RATE
TYPE I	MARCH THROUGH SEPTEMBER	BERMUDA GRASS, HULLED 50-LB (22.7-KG) PLS PER ACRE
TYPE II	OCTOBER THROUGH FEBRUARY	RYE GRASS, 100-LB (45.4-KG) PLS PER ACRE COMBINED WITH BERMUDA GRASS, HULLED 20-LB (9.1-KG) PLS PER ACRE.
OTHER	AS SPECIFIED ON PLANS	AS SPECIFIED ON PLANS

¹PLS - Pure Live Seed is determined by multiplying the gross weight times purity times the germination [For example, a 100-lb bag with 85% purity and 80% germination. (PLS=pounds in bag x Purity x germination) 100 x 0.85 x 0.8 = 60.8 -lbs of pure live seed.]

- (6) Seeded areas shall be maintained, including watering and mowing, at such time and in a manner and quality to establish a minimum 80% evenly distributed ground cover, without large bare areas, until completion and final acceptance of the project by the Town.

NOTES:

- (1) A SECTION OF FILTER FABRIC SHALL BE REMOVED AS SHOWN ON THIS DETAIL TO PROVIDE A 4-INCH MINIMUM CLEAR OPENING. FABRIC MUST BE SECURED TO WIRE BACKING WITH CLIPS OR HOG RINGS AT THIS LOCATION.
- (2) INSPECTION SHALL BE MADE BY THE CONTRACTOR AND SILT ACCUMULATION MUST BE REMOVED WHEN DEPTH REACHES 2-INCHES.
- (3) CONTRACTOR SHALL MONITOR THE PERFORMANCE OF INLET PROTECTION DURING EACH RAINFALL EVENT AND IMMEDIATELY REMOVE THE INLET PROTECTIONS IF THE STORM-WATER BEGINS TO OVERTOP THE CURB.
- (4) INLET PROTECTIONS SHALL BE REMOVED AS SOON AS THE SOURCE OF SEDIMENT IS STABILIZED.

INLET OPENING	MINIMUM NUMBER OF SAND BAGS	
	TOP	FRONT
5'	2	3
10'	3	3
15'	3	4
20'	4	4

EC-2

<p>CERTIFICATION: THIS TOWN OF NORTHLAKE STANDARD DETAIL SHEET IS AUTHORIZED FOR USE IN THIS PROJECT BY THE ENGINEER WHOSE SEAL APPEARS ON THIS SHEET. THIS ENGINEER IS ALSO CERTIFYING THAT THE CONTENT OF THE DETAILS AND NOTES ON THIS SHEET HAVE NOT BEEN ALTERED FROM THAT RECEIVED FROM THE TOWN OF NORTHLAKE.</p>							EROSION CONTROL STANDARD DETAILS						
							EROSION CONTROL DETAILS (SHEET 2 OF 2)						
 THE TOWN OF NORTHLAKE TEXAS							DESIGN	DRAWN	CHECK	DATE	SCALE	FILE	NO.
							HALFF	HALFF	HALFF	AUG 2023	N. T. S.	EC-2	—